



CHAPTER THREE

Fire Department Signage

Contents:


- Fire Department Connection (FDC) Signage
- Sprinkler Riser Room Signage
- FACP Signage
- Fire Protection System Signage
- Fire Department Command Center Signage

Purpose:

Properly identified fire protection systems will enable Firefighters to more efficiently do their job. This means a better outcome for the property owner.




FDC SIGN DETAIL

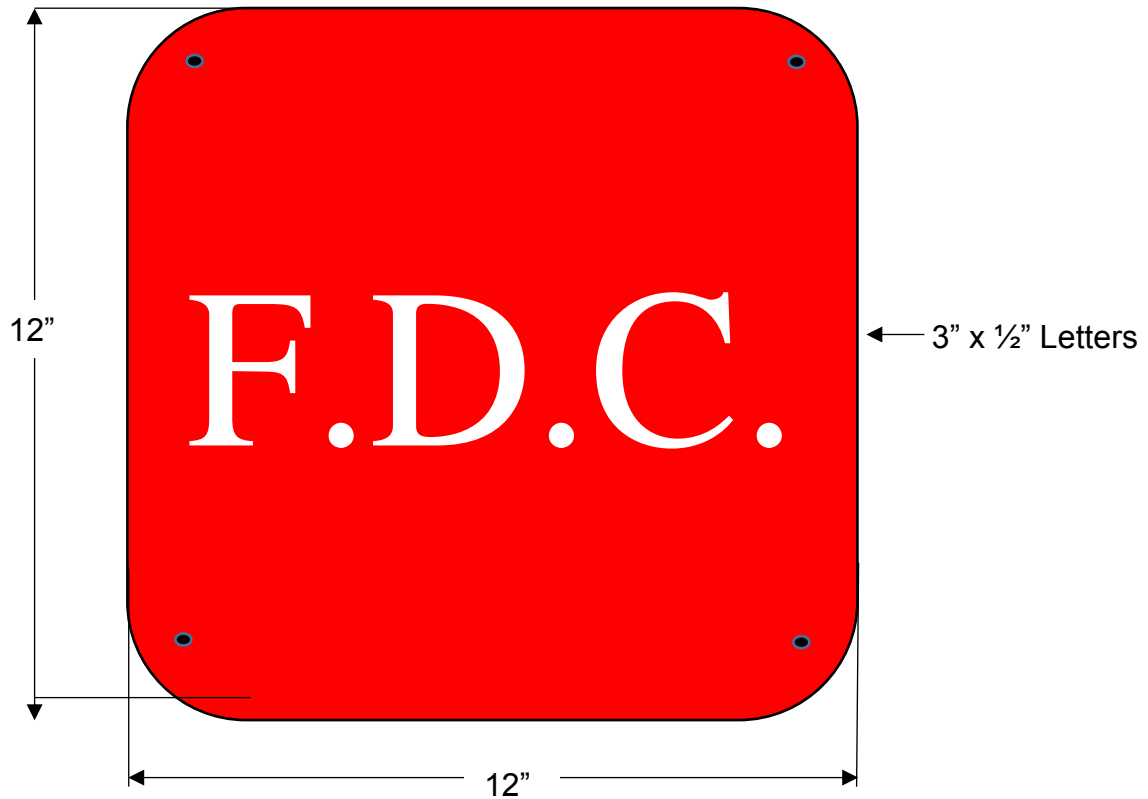

1. The sign plate shall be a minimum size of 12X12 inches square, durable, weather-proof, and permanently installed.
2. Sign to be installed on the wall over the FDC valve, above the FDC and clearly visible from the roadway in all lighting conditions.


FDC SIGN WITH ADDRESS NUMBERS DETAIL

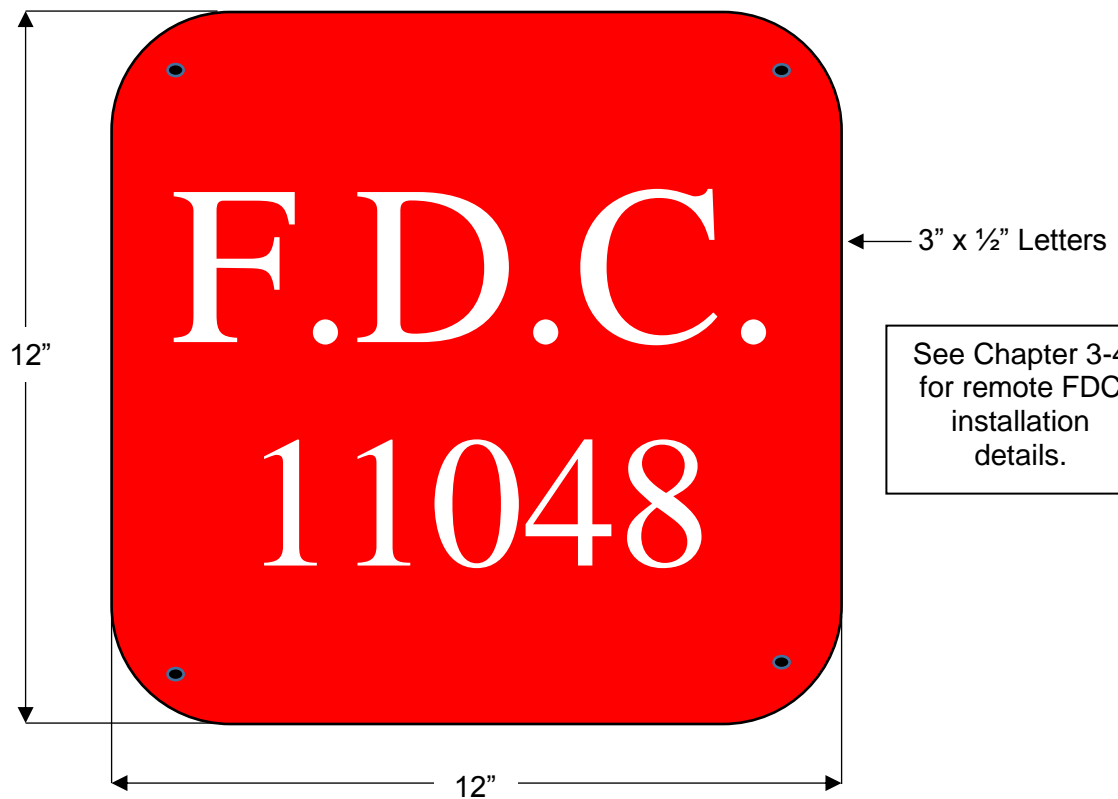

1. The sign plate shall be a minimum size of 12X12 inches square, durable, weather-proof, and permanently installed.




ALTERNATE FDC SIGN DETAILS

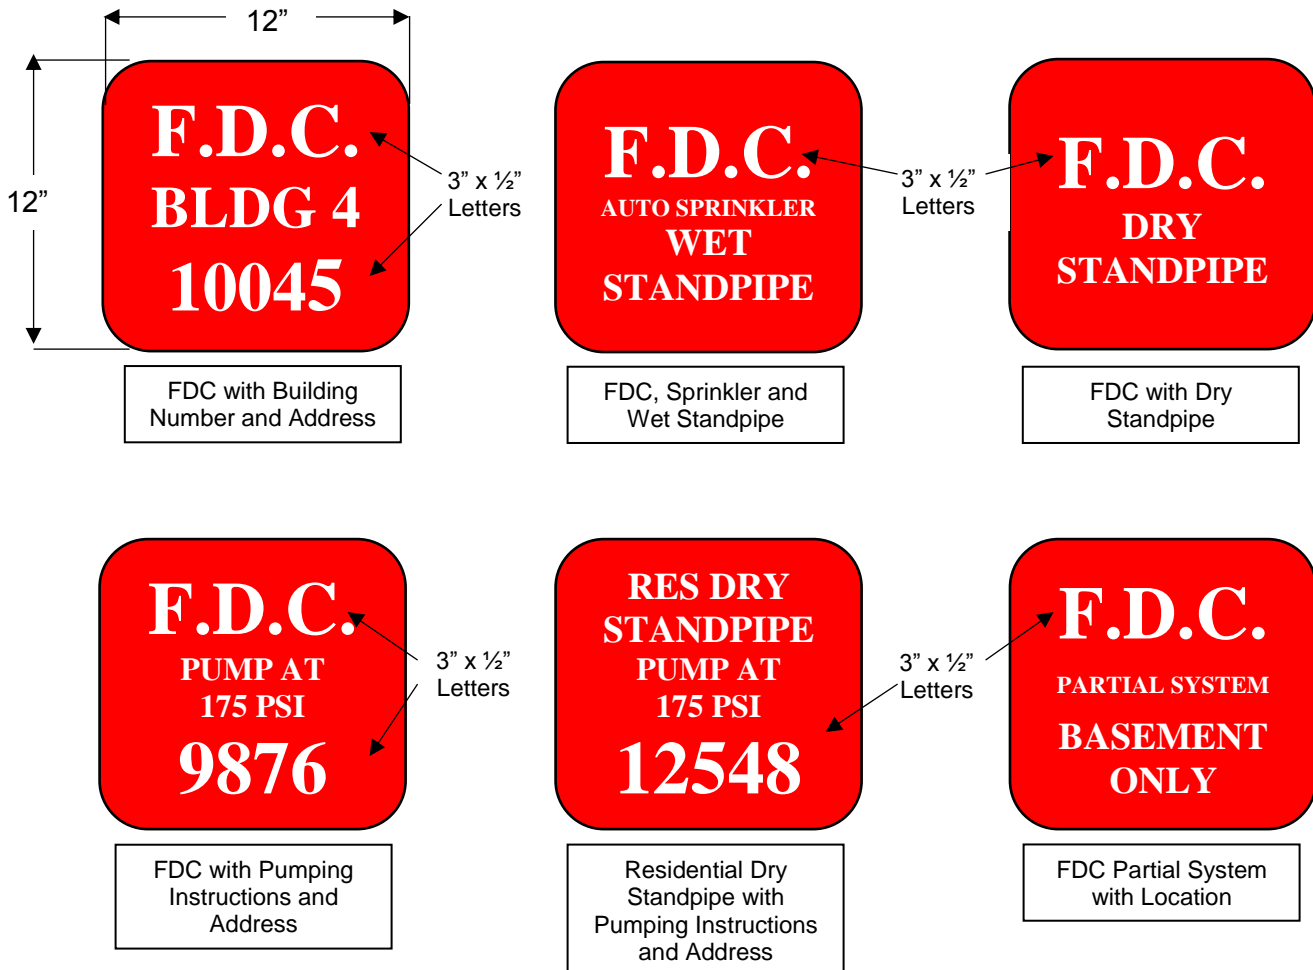

1. The sign plate shall be a minimum size of 12X12 inches, durable, weather-proof, and permanently installed.



REMOTE FDC SIGN INSTALLATION

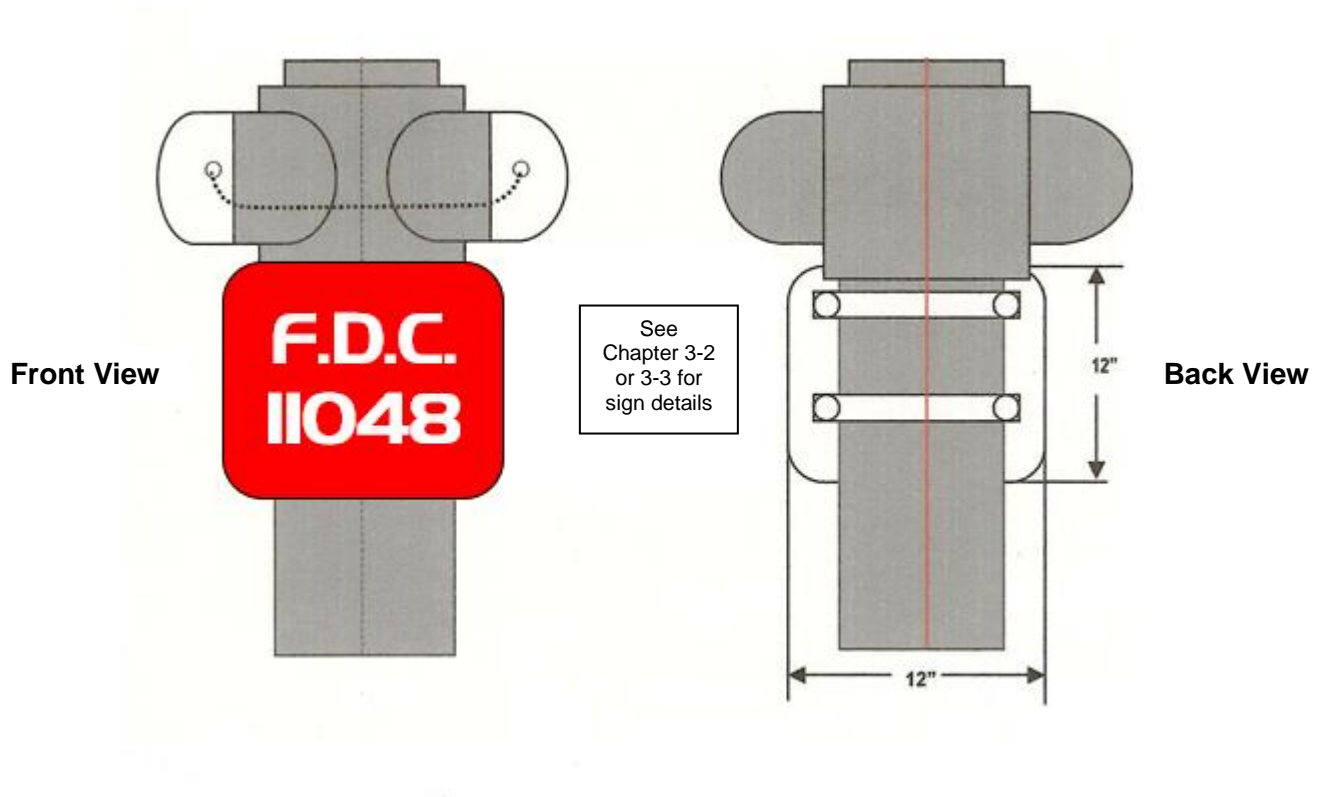

1. The sign plate shall be a minimum size of 12X12 inches, durable, weather-proof, and permanently installed.
2. Install sign using two mounting straps with nut and bolt fasteners.



FDC SIGN EXAMPLES






FIRE DEPARTMENT SPRINKLER RISER ROOM SIGN




1½" LETTERING WITH
.344 STROKE
(BETWEEN 5/16" & 3/8")

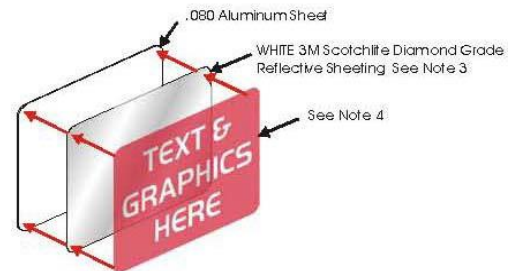

1. The sign plate shall be a minimum size of 12 x12 inches square, durable, weather-proof, permanently installed and readily visible.




FACP & RISER ROOM IDENTIFICATION SIGN DETAIL

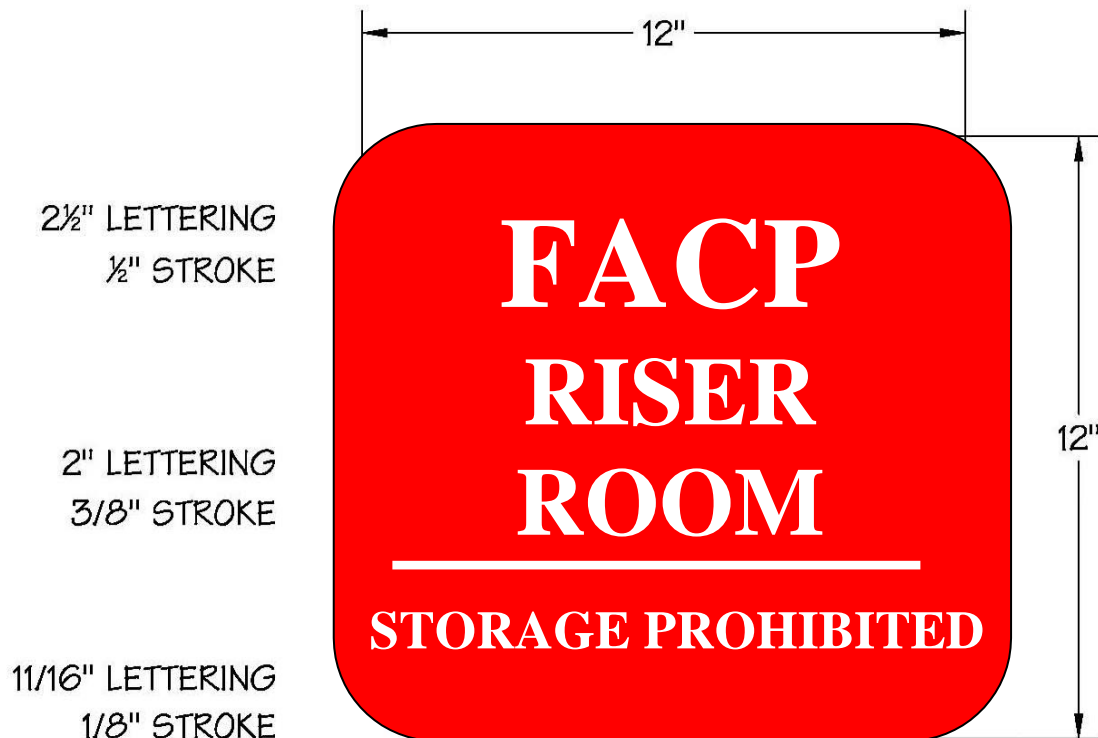

2. The sign plate shall be a minimum size of 12X12 inches, durable, weather-proof, and permanently installed.



EXTERIOR FACP IDENTIFICATION SIGN DETAIL

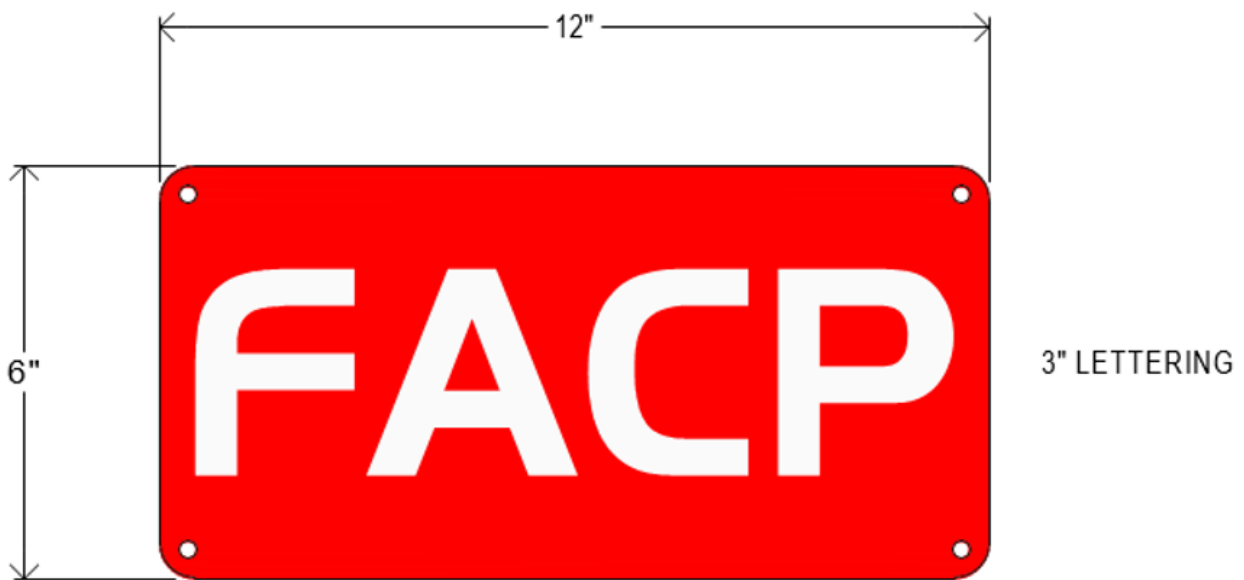

1. The sign plate shall be a minimum size of 12X6 inches, durable, weather-proof, and permanently installed.




INTERIOR FIRE ALARM CONTROL PANEL SIGNAGE

Signage identifying Fire Alarm Control Panel (FACP) locations inside buildings may be installed in a style consistent with other signage installed in the building.





FIRE DEPARTMENT ACCESS SIGN DETAIL

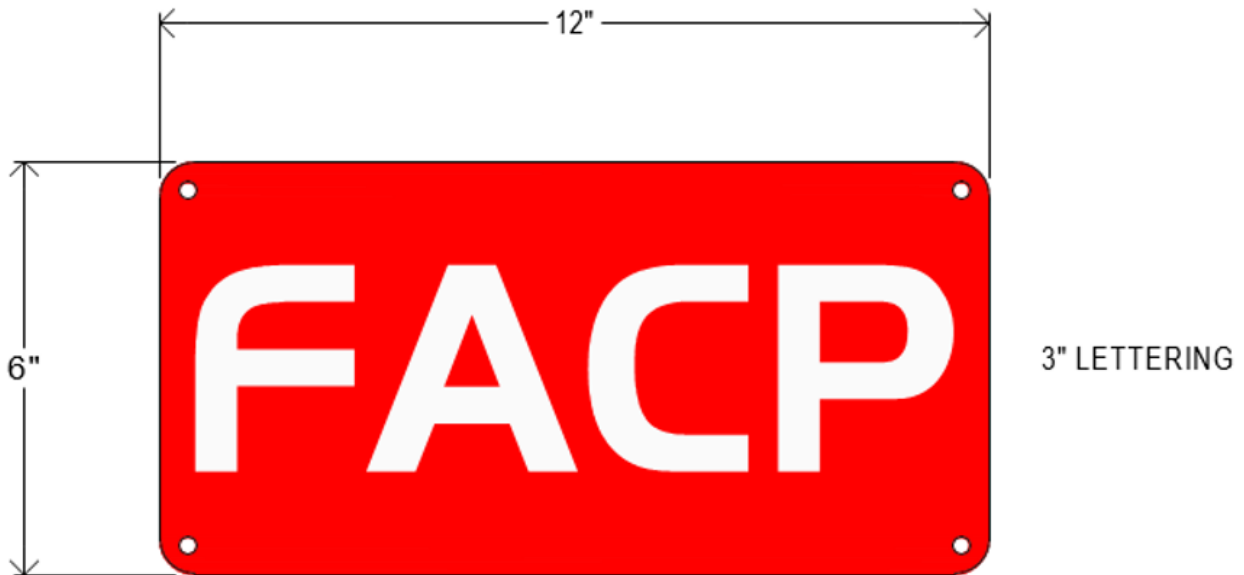

1. The sign plate shall be a minimum size of 8 x4 inches, durable, weather-proof, permanently installed, and readily visible in all lighting conditions.

This sign is typically used with gates. See Chapter 6: Automatic Electric Gates and Chapter 7: Manual and Pedestrian Gates for sign placement.




FDC, RISER ROOM, KNOX BOX EXAMPLE






WET STANDPIPE SIGN DETAIL

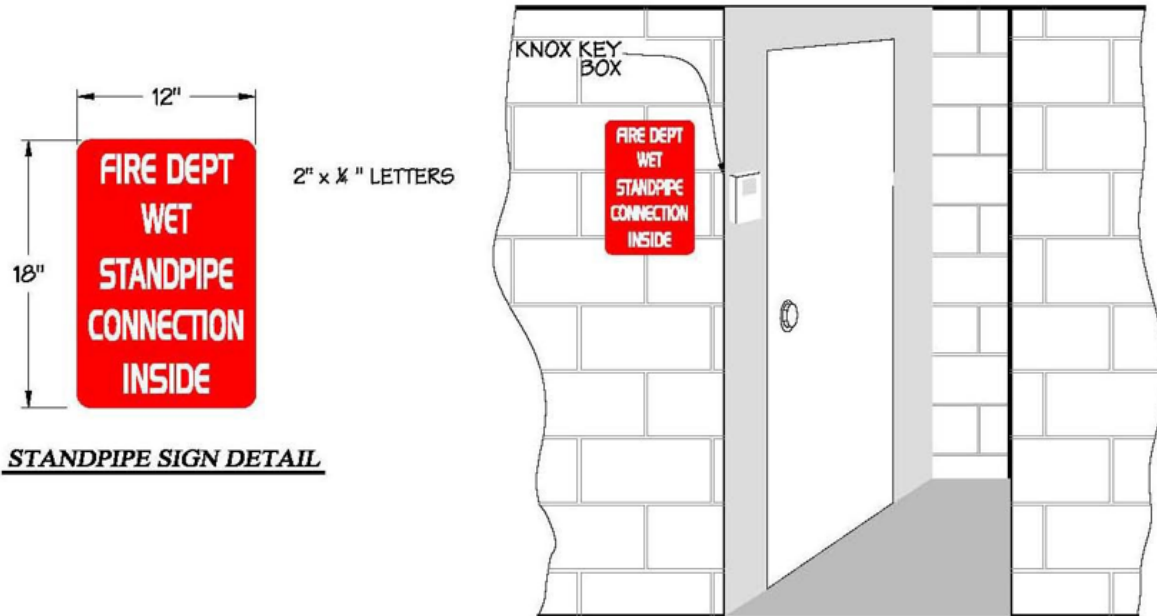

1. The sign plate shall be 12 X 18 inches, durable, weather-proof, permanently installed, and readily visible under all lighting conditions.
2. Install KNOX BOX SERIES #3200 next to lock on Fire Department access door. See Chapter 4-1 for Knox box ordering information.




SPECIAL FIRE DEPARTMENT FIRE PUMP TEST HEADER SIGN DETAIL

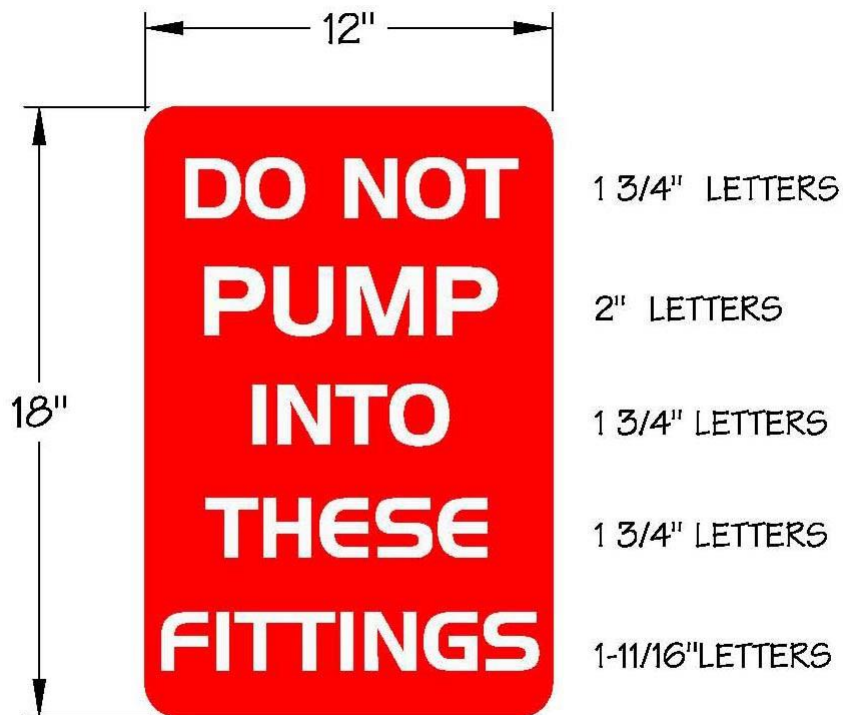

1. The sign plate shall be a minimum size of 12X18 inches, durable, weather-proof, permanently installed, and readily visible in all lighting conditions.
2. Additional kerning between letters as shown.
3. Mount on four corners.



SPRINKLER CONTROL VALVE FOR ZONE APPLICATIONS SIGN DETAIL

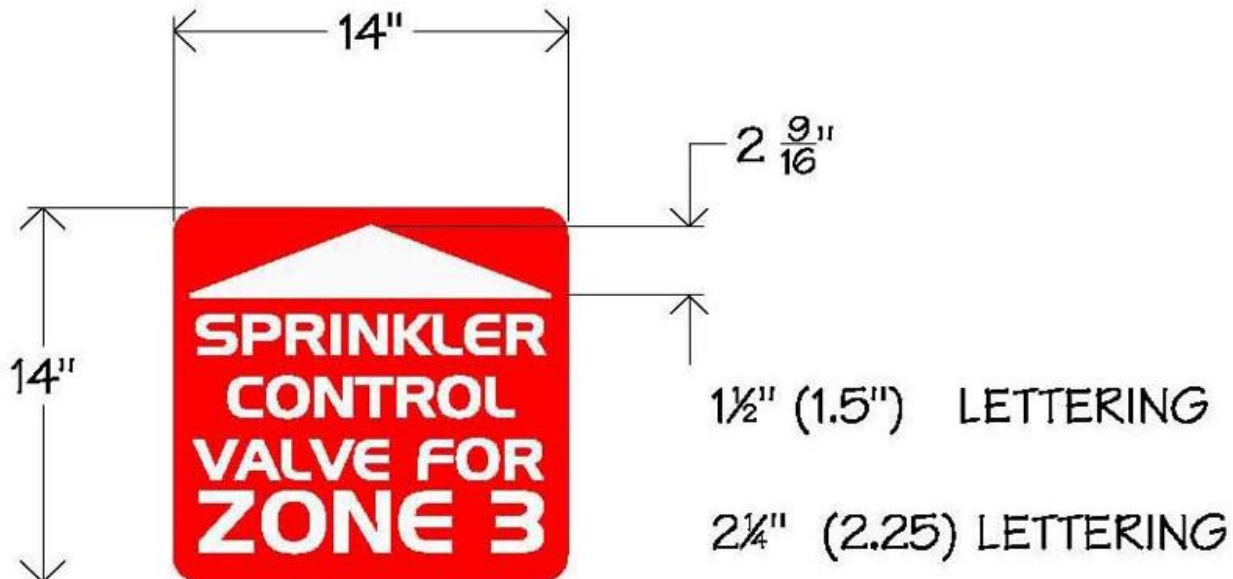


SPRINKLER VALVE SIGN

1. The sign plate shall be a minimum size of 14 x 14 inches square, durable, weather-proof, permanently installed, and readily visible in all lighting conditions.




POST INDICATOR VALVE SIGN DETAIL

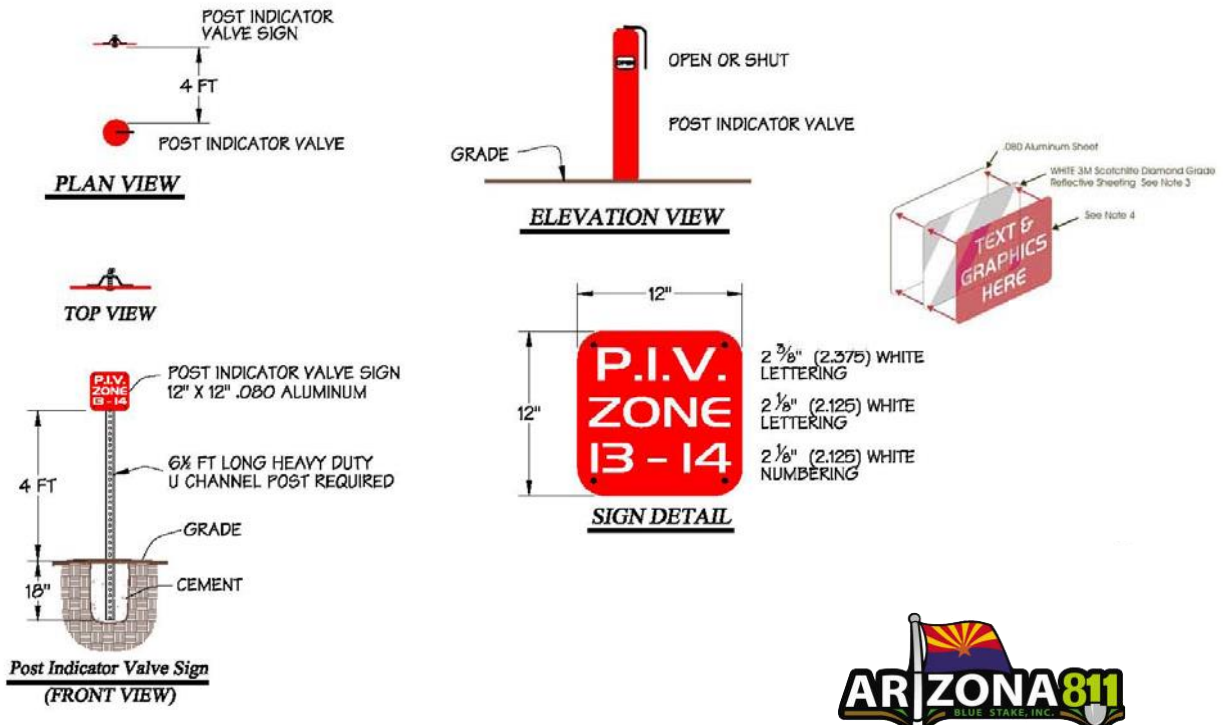

1. The sign plate shall be 12 x 12 inches square, durable, weather-proof, permanently installed, and readily visible in all lighting conditions.



FIRE DEPARTMENT COMMAND CENTER SIGN DETAIL

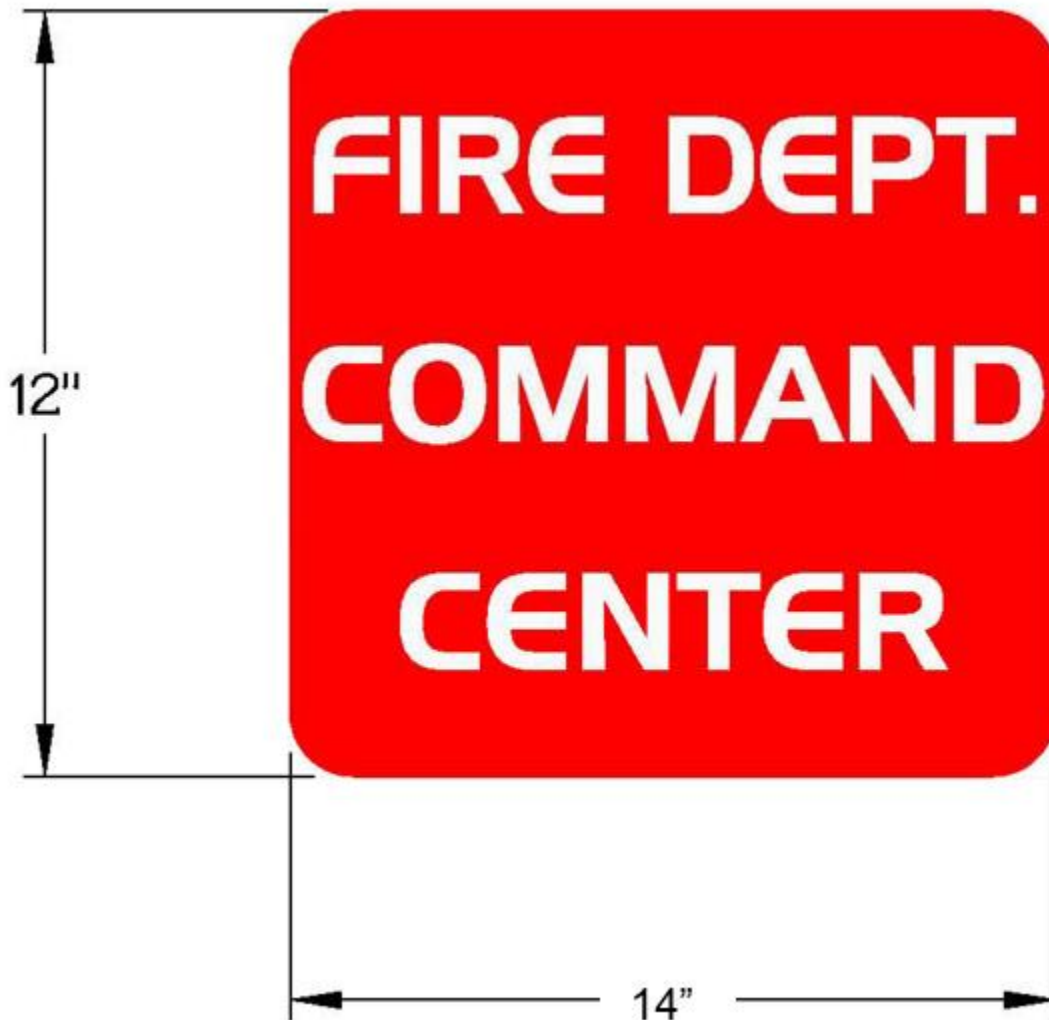

1½" LETTERING WITH
.344 STROKE
(BETWEEN 5/16" & 3/8")

1. The sign plate shall be 12 X 14 inches square, durable, weather-proof, permanently installed, and readily visible in all lighting conditions.



FIRE DEPARTMENT COMMAND CENTER SIGN WITH KNOX BOX EXAMPLES

