



CHAPTER EIGHT

Hazardous Materials Identification

Contents:


- 704 Fire Diamonds
- HAZ MAT ID Signage

Purpose:

Emergency responders must be aware of any Hazardous Materials involved in any emergency. This signage will help protect emergency responders by identifying hazard types in locations where hazardous materials exist.



HAZARDOUS MATERIALS IDENTIFICATION (NFPA 704 FIRE DIAMOND)

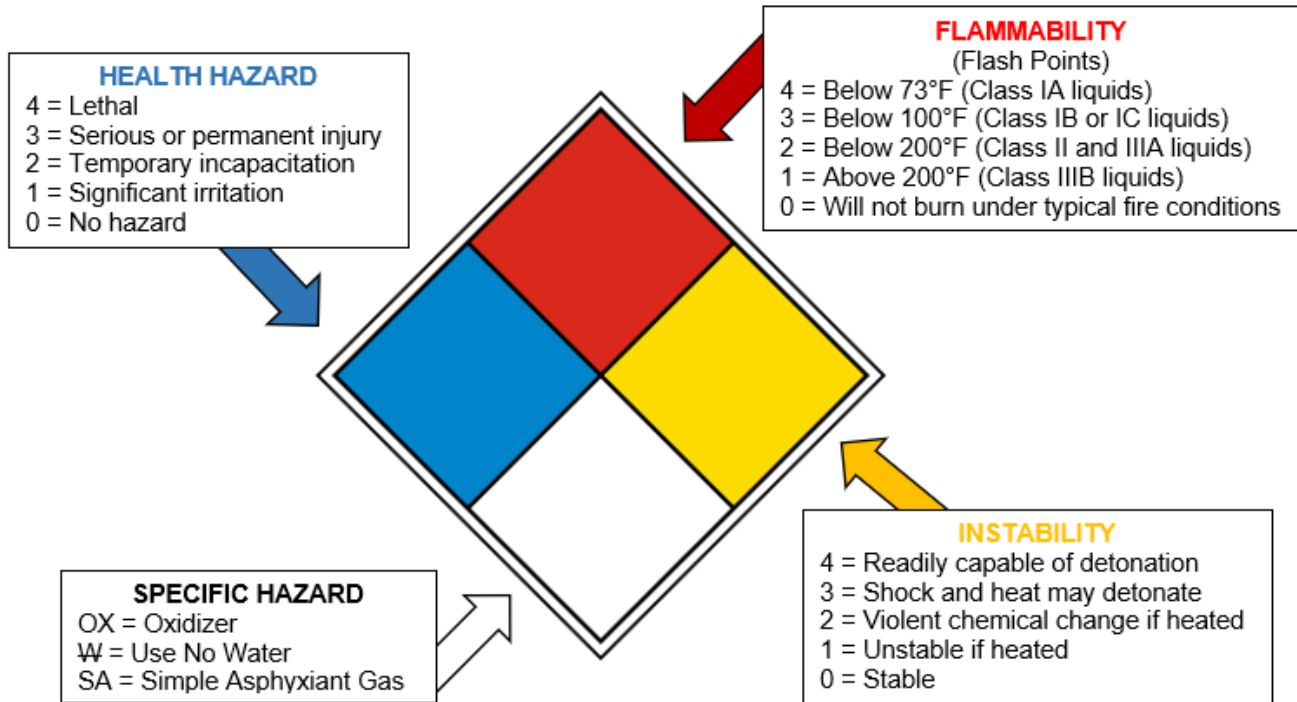

1. The sign plate shall be square, durable, weather-proof, permanently installed and readily visible. Size to be 15" with 6" lettering or as determined by the Fire Inspector or Fire Code Official based on hazards.
2. The sign face shall have a reflective vinyl background.
3. Numbers and letters shall be black.
4. Signs shall be posted at locations as required and approved by the Golder Ranch Fire District.




NFPA 704 PLACARD EXAMPLES





FIRE DEPARTMENT SPECIAL APPLICATION HAZ MAT SIGN

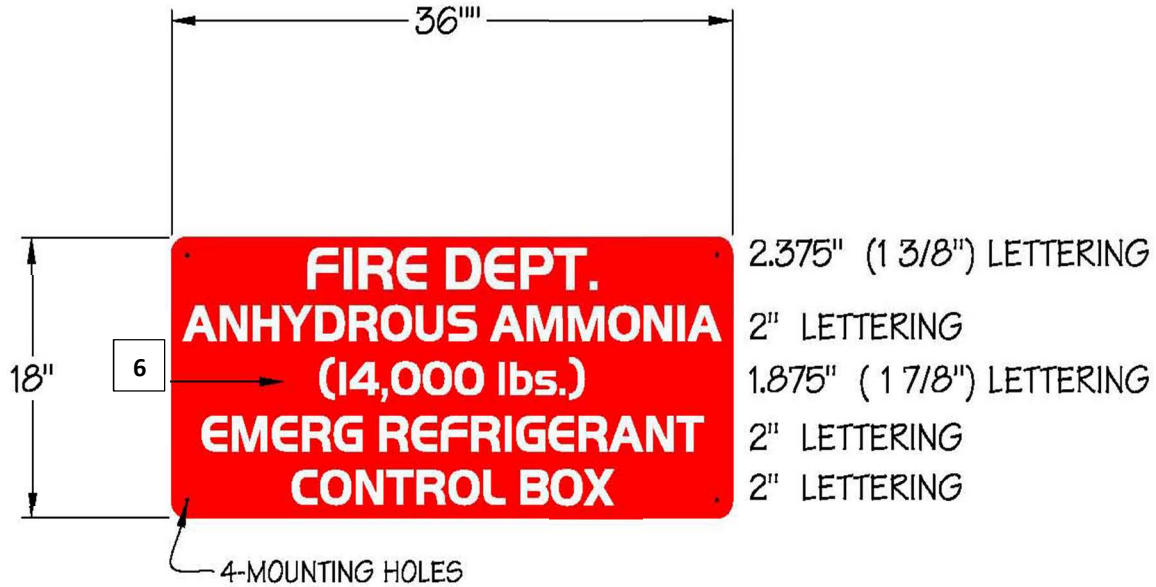

1. The sign plate shall be a minimum of 36x18 inches, durable, weather-proof, and permanently installed.
2. Additional kerning between letters as shown.
3. Number of pounds changes according to system.